



3310-C Gilmore Industrial Boulevard  
Louisville, Kentucky 40213

Phone (502) 964-8737  
Facsimile (502) 964-1123

## Facility Asbestos Inspection

**Facility:** 716 East 11<sup>th</sup> Street      **Inspection Date:** June 29, 2010  
**Location:** New Albany, Indiana      **Inspector:** Welsh, Leow

Micro-Analytics, Inc. conducted a facility asbestos inspection at the facility identified above on the date indicated. The asbestos inspection was performed in accordance with the EPA recommended protocol for a facility asbestos inspection.

During the site inspection, suspect asbestos-containing materials were grouped into homogeneous areas (HA's), with any given homogeneous area being a material exhibiting the same color, texture, and physical appearance. Each suspect homogeneous area was then sampled in accordance with EPA protocol, and each sample collected was given a unique identification number.

Collected samples were then analyzed by an AIHA accredited laboratory using Polarized Light Microscopy (PLM) and the dispersion staining technique, which is the EPA-approved method for the analysis of bulk materials for the presence of asbestos.

This report summarizes the findings of the facility inspection. The report includes:

- An Asbestos Materials Summary Form, which details all of the asbestos-containing materials that were discovered during the inspection.
  - A Homogeneous Area Summary Form, which details all HA's that were identified during the inspection and includes both asbestos-containing materials and non-asbestos materials.
  - A Facility Drawing which shows locations of the samples collected and identifies the areas where asbestos materials are present in the facility.
  - A Bulk Analysis Report, which shows the analytical results from the laboratory for the PLM analysis.
-

## Facility Asbestos Inspection – Summary of Asbestos-Containing Materials

Facility: 716 East 11<sup>th</sup> Street – Single Family Dwelling

Date of Inspection: 06-29-10

Location New Albany, Indiana

Inspector: Pete Welsh

HA No.	Material Type	Description	Locations of Material	Material Quantity	Condition of ACM	Type & Percent Asbestos
09	Misc	Transite Siding	Exterior	1,600 S.F.	Good	Chrysotile 15-20%

## Facility Asbestos Inspection – Summary of Homogeneous Areas


Facility: 716 East 11<sup>th</sup> Street – Single Family Dwelling

Date of Inspection: 06-29-10

Location New Albany, Indiana

Inspector: Pete Welsh

HA No.	Description	Locations of Material	Material Quantity	Material Type	Sample Numbers	Is Asbestos Present?
01	12" Floor Tile/Glue	Stairwell/Landing	N/A	Misc	1.1 – 1.3	NO ACM
02	Linoleum	Kitchen	N/A	Misc	2.1 – 2.3	NO ACM
03	Textured Ceiling Finish	Bedrooms 1 and 3	N/A	Surf	3.1 – 3.3	NO ACM
04	Plaster	Bedrooms 1, 2 and 3	N/A	Surf	4.1 – 4.3	NO ACM
05	Drywall/Mud Compound	Bedroom 2 Closet, Mudroom	N/A	Misc	5.1 – 5.3	NO ACM
06	Wire Insulation	Throughout	N/A	Misc	6.1 – 6.3	NO ACM
07	Window Caulk/Glazing	Exterior	N/A	Misc	7.1 – 7.3	NO ACM
08	Felt Under Siding	Throughout	N/A	Misc	8.1 – 8.3	NO ACM
09	Transite Siding	Exterior	1,600 S.F.	Misc	9.1 – 9.3	Chrysotile 15-20%
10	Rolled Roofing	Porch/Rear Annex	N/A	Misc	10.1 – 10.3	NO ACM
11	Roof Shingle	Main Roof	N/A	Misc	11.1 – 11.3	NO ACM

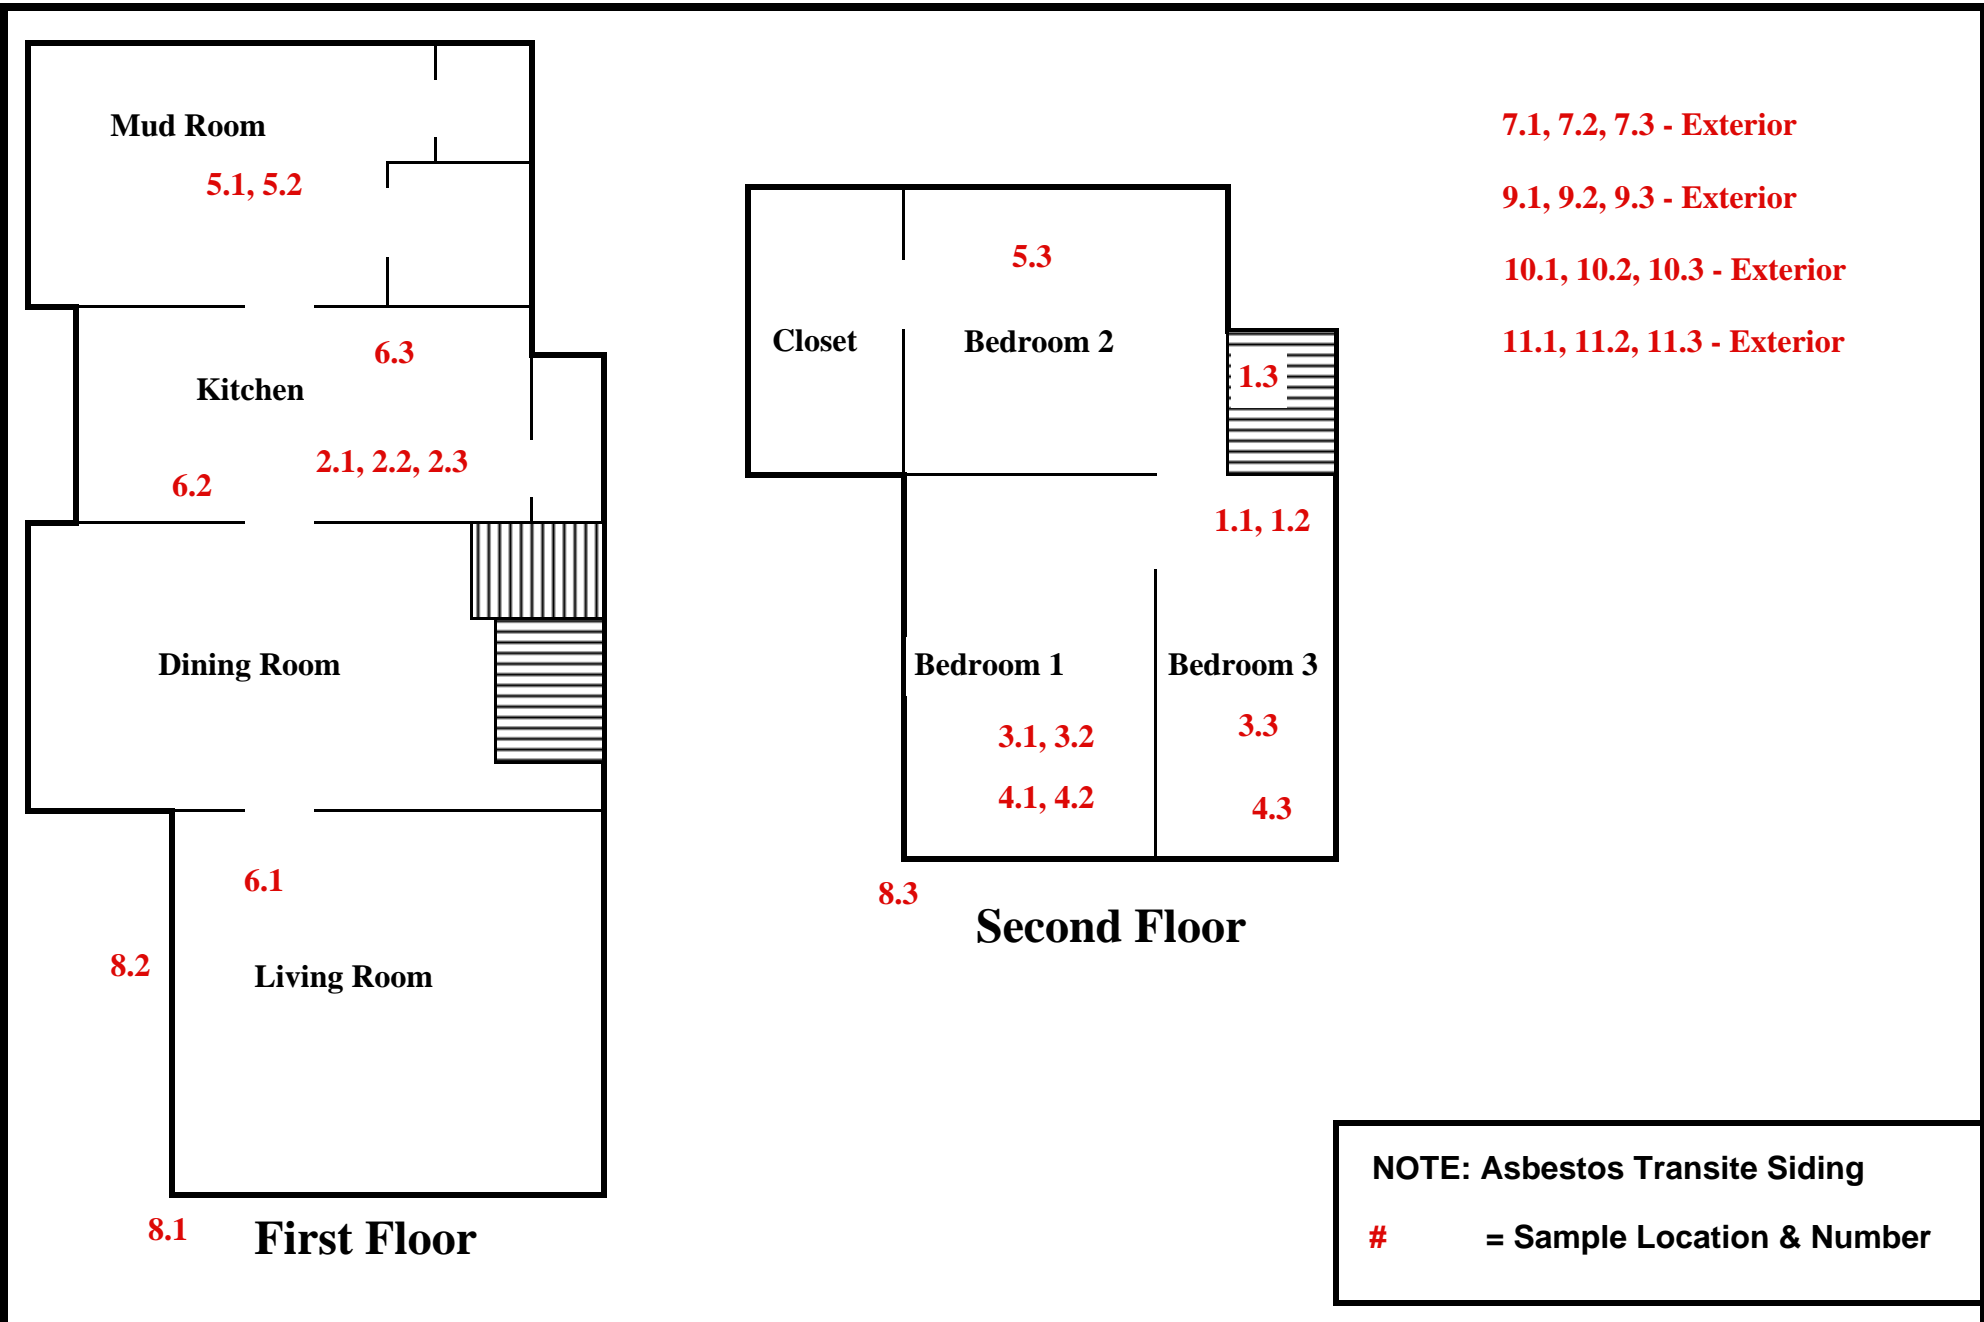

Micro-Analytics, Inc.  
3310-C Gilmore Ind. Blvd.  
Louisville, Kentucky 40213

716 East 11th Street, New Albany, Indiana

Project No.: 62833

Drawn by: N. Leow

Scale: Not to scale

Date: 07-07-10

# MRS Analytical Laboratory, Inc.

## Bulk Asbestos Report

**Project Number:** 62833 **Date Received:** 06/29/2010  
**Client:** New Directions Housing Corporation **Date Reported:** 06/29/2010  
**Facility:** 716 East 11<sup>th</sup> Street **Analysis Date:** 06/29/2010  
**Sample Type:** Bulk Material **Analyst:** J. Holley  
**Date Sampled:** 06/29/2010 **Sampled By:** P. Welsh/N. Leow

**TEST DESCRIPTION:** Analysis of Bulk Material for Asbestos.

**ANALYTICAL METHOD:** Polarized Light Microscopy with Dispersion Staining as Defined in 40 CFR, Part 763, Subpart F, Appendix A.

<i>Micro-Analytcs Sample Number</i>	<i>Client Sample Number and Laboratory Gross Description</i>	<i>Type and Percent Asbestos</i>
1.1	12" Floor Tile	NAD
	Glue	NAD
1.2	12" Floor Tile	NAD
	Glue	NAD
1.3	12" Floor Tile	NAD
	Glue	NAD
2.1	Linoleum	NAD
2.2	Linoleum	NAD
2.3	Linoleum	NAD
3.1	Textured Ceiling Finish	NAD
3.2	Textured Ceiling Finish	NAD
3.3	Textured Ceiling Finish	NAD
4.1	Plaster Top – white	NAD
	Plaster Bottom – gray	NAD
4.2	Plaster Top – white	NAD
	Plaster Bottom – gray	NAD
4.3	Plaster Top – white	NAD
	Plaster Bottom – gray	NAD
5.1	Drywall / Mud Compound	NAD
5.2	Drywall / Mud Compound	NAD

**Reporting Limit** 1% Asbestos

**NAD:** No Asbestos Detected

MRS Analytical Laboratory, Inc., is accredited and certified Proficient by the American Industrial Hygiene Association – Accreditation Number: AIHA-102459

Reviewed by Authorized Signatory



# MRS Analytical Laboratory, Inc.

## Bulk Asbestos Report

**Project Number:** 62833 **Date Received:** 06/29/2010  
**Client:** New Directions Housing Corporation **Date Reported:** 06/29/2010  
**Facility:** 716 East 11<sup>th</sup> Street **Analysis Date:** 06/29/2010  
**Sample Type:** Bulk Material **Analyst:** J. Holley  
**Date Sampled:** 06/29/2010 **Sampled By:** P. Welsh/N. Leow

**TEST DESCRIPTION:** Analysis of Bulk Material for Asbestos.

**ANALYTICAL METHOD:** Polarized Light Microscopy with Dispersion Staining as Defined in 40 CFR, Part 763, Subpart F, Appendix A.

<i>Micro-Analytcs Sample Number</i>	<i>Client Sample Number and Laboratory Gross Description</i>	<i>Type and Percent Asbestos</i>
5.3	Drywall / Mud Compound	NAD
6.1	Wire Insulation	NAD
6.2	Wire Insulation	NAD
6.3	Wire Insulation	NAD
7.1	Window Caulk / Glazing	NAD
7.2	Window Caulk / Glazing	NAD
7.3	Window Caulk / Glazing	NAD
8.1	Felt Under Siding	NAD
8.2	Felt Under Siding	NAD
8.3	Felt Under Siding	NAD
9.1	Transite Siding	Chrysotile 15-20
9.2	Transite Siding	Chrysotile 15-20
9.3	Transite Siding	Chrysotile 15-20
10.1	Rolled Roofing	NAD
10.2	Rolled Roofing	NAD
10.3	Rolled Roofing	NAD
11.1	Roof Shingle	NAD
11.2	Roof Shingle	NAD
11.3	Roof Shingle	NAD

**Reporting Limit** 1% Asbestos

**NAD:** No Asbestos Detected

MRS Analytical Laboratory, Inc., is accredited and certified Proficient by the American Industrial Hygiene Association – Accreditation Number: AIHA-102459

Reviewed by Authorized Signatory

