



3310-C Gilmore Industrial Boulevard
Louisville, Kentucky 40213

Phone (502) 964-8737
Facsimile (502) 964-1123

Facility Asbestos Inspection

Facility: 325 East 13th Street **Inspection Date:** June 13, 2010
Location: New Albany, Indiana **Inspector:** Welsh, Cooper

Micro-Analytics, Inc. conducted a facility asbestos inspection at the facility identified above on the date indicated. The asbestos inspection was performed in accordance with the EPA recommended protocol for a facility asbestos inspection.

During the site inspection, suspect asbestos-containing materials were grouped into homogeneous areas (HA's), with any given homogeneous area being a material exhibiting the same color, texture, and physical appearance. Each suspect homogeneous area was then sampled in accordance with EPA protocol, and each sample collected was given a unique identification number.

Collected samples were then analyzed by an AIHA accredited laboratory using Polarized Light Microscopy (PLM) and the dispersion staining technique, which is the EPA-approved method for the analysis of bulk materials for the presence of asbestos.

This report summarizes the findings of the facility inspection. The report includes:

- An Asbestos Materials Summary Form, which details all of the asbestos-containing materials that were discovered during the inspection.
 - A Homogeneous Area Summary Form, which details all HA's that were identified during the inspection and includes both asbestos-containing materials and non-asbestos materials.
 - A Facility Drawing which shows locations of the samples collected and identifies the areas where asbestos materials are present in the facility.
 - A Bulk Analysis Report, which shows the analytical results from the laboratory for the PLM analysis.
-

Facility Asbestos Inspection – Summary of Asbestos-Containing Materials

Facility: 325 East 13th Street – Single Family Dwelling

Date of Inspection: 07-13-2010

Location New Albany, Indiana

Inspector: Welsh, Cooper

HA No.	Material Type	Description	Locations of Material	Material Quantity	Condition of ACM	Type & Percent Asbestos
NO ASBESTOS DETECTED						

Facility Asbestos Inspection – Summary of Homogeneous Areas


Facility: 325 East 13th Street – Single Family Dwelling

Date of Inspection: 07-13-2010

Location New Albany, Indiana

Inspector: Welsh, Cooper

HA No.	Description	Locations of Material	Material Quantity	Material Type	Sample Numbers	Is Asbestos Present?
01	Pad under ceramic tile	Kitchen, Bathroom	N/A	Misc	1.1 – 1.3	NO ACM
02	Flooring under pad	Kitchen, Bathroom	N/A	Misc	2.1 – 2.3	NO ACM
03	Plaster	Throughout	N/A	Misc	3.1 – 3.3	NO ACM
04	12” spline ceiling tiles	Kitchen	N/A	Misc	4.1 – 4.3	NO ACM
05	2x4 lay-in ceiling tiles	Living Room	N/A	Misc	5.1 – 5.3	NO ACM
06	2x4 lay-in ceiling tiles	Bathroom	N/A	Misc	6.1 – 6.3	NO ACM
07	Fireplace insulation paper	Living Room	N/A	Misc	7.1	NO ACM
08	Loose insulation	Attic	N/A	Misc	8.1 – 8.3	NO ACM

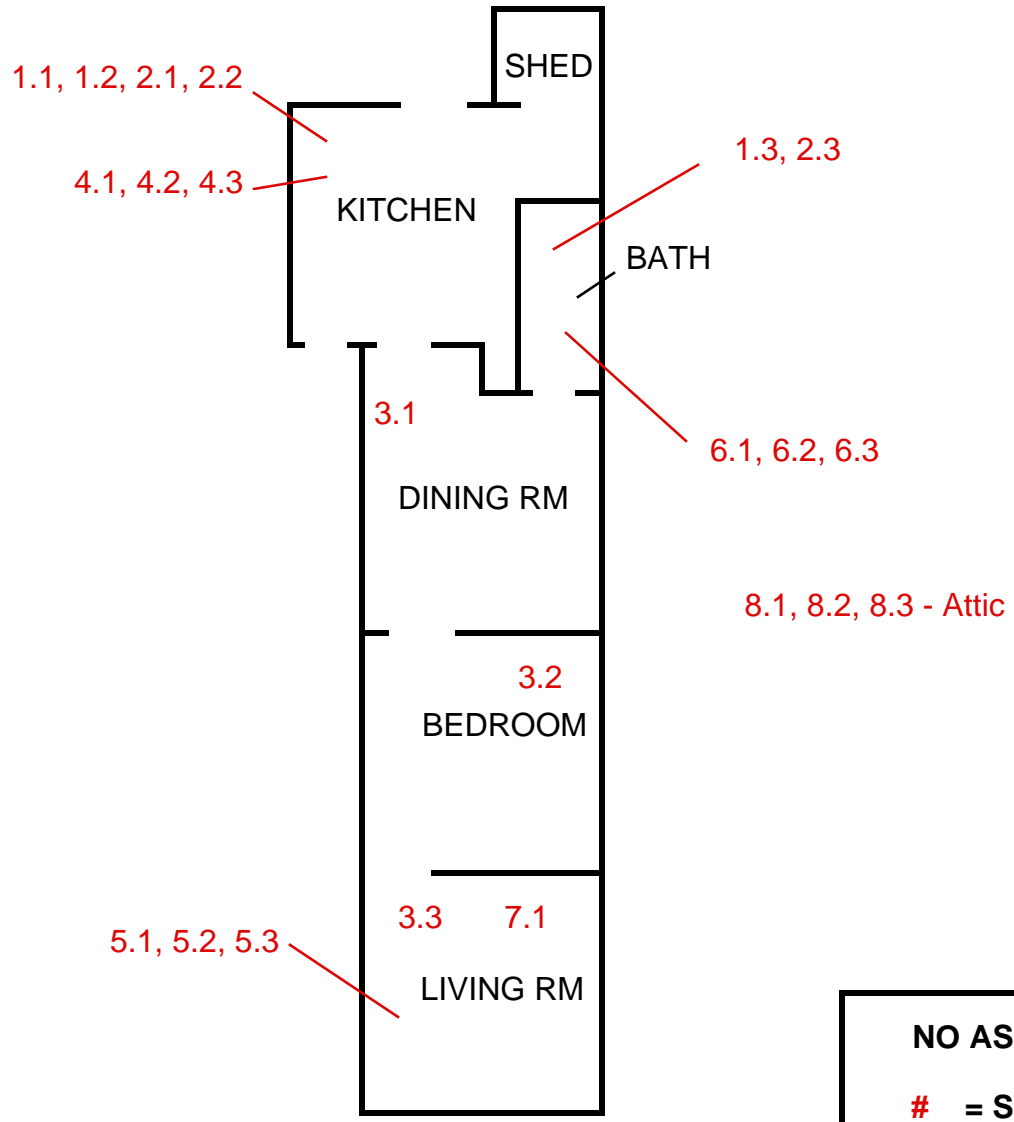

NO ASBESTOS DETECTED
= Sample Location & Number

Micro-Analytics, Inc.
 3310-C Gilmore Ind. Blvd.
 Louisville, Kentucky 40213

325 East 13th Street, New Albany, Indiana

Project No.: 62833

Drawn by: N. Leow

Scale: Not to scale

Date: 07-15-10

MRS Analytical Laboratory, Inc.

Bulk Asbestos Report

Project Number: 62833 **Date Received:** 07/13/2010
Client: New Directions Housing Corporation **Date Reported:** 07/14/2010
Facility: 325 E. 13th Street **Analysis Date:** 07/14/2010
Sample Type: Bulk Material **Analyst:** J. Holley
Date Sampled: 07/13/2010 **Sampled By:** P. Welsh

TEST DESCRIPTION: Analysis of Bulk Material for Asbestos.

ANALYTICAL METHOD: Polarized Light Microscopy with Dispersion Staining as Defined in 40 CFR, Part 763, Subpart F, Appendix A.

<i>Micro-Analytcs Sample Number</i>	<i>Client Sample Number and Laboratory Gross Description</i>	<i>Type and Percent Asbestos</i>
1.1	Pad under ceramic tile	NAD
1.2	Pad under ceramic tile	NAD
1.3	Pad under ceramic tile	NAD
2.1	Flooring under pad	NAD
2.2	Flooring under pad	NAD
2.3	Flooring under pad	NAD
3.1	Plaster	NAD
3.2	Plaster	NAD
3.3	Plaster	NAD
4.1	12" (Spline) Acoustic Ceiling tile	NAD
4.2	12" (Spline) Acoustic Ceiling tile	NAD
4.3	12" (Spline) Acoustic Ceiling tile	NAD
5.1	2x4 Lay-in Ceiling Tile	NAD
5.2	2x4 Lay-in Ceiling Tile	NAD
5.3	2x4 Lay-in Ceiling Tile	NAD
6.1	2x4 Lay-in Ceiling Tile	NAD
6.2	2x4 Lay-in Ceiling Tile	NAD
6.3	2x4 Lay-in Ceiling Tile	NAD
7.1	Fireplace insulation paper	NAD
8.1	Loose insulation	NAD
8.2	Loose insulation	NAD
8.3	Loose insulation	NAD

Reporting Limit 1% Asbestos

NAD: No Asbestos Detected

MRS Analytical Laboratory, Inc., is accredited and certified Proficient by the American Industrial Hygiene Association – Accreditation Number: AIHA-102459

Reviewed by Authorized Signatory

